
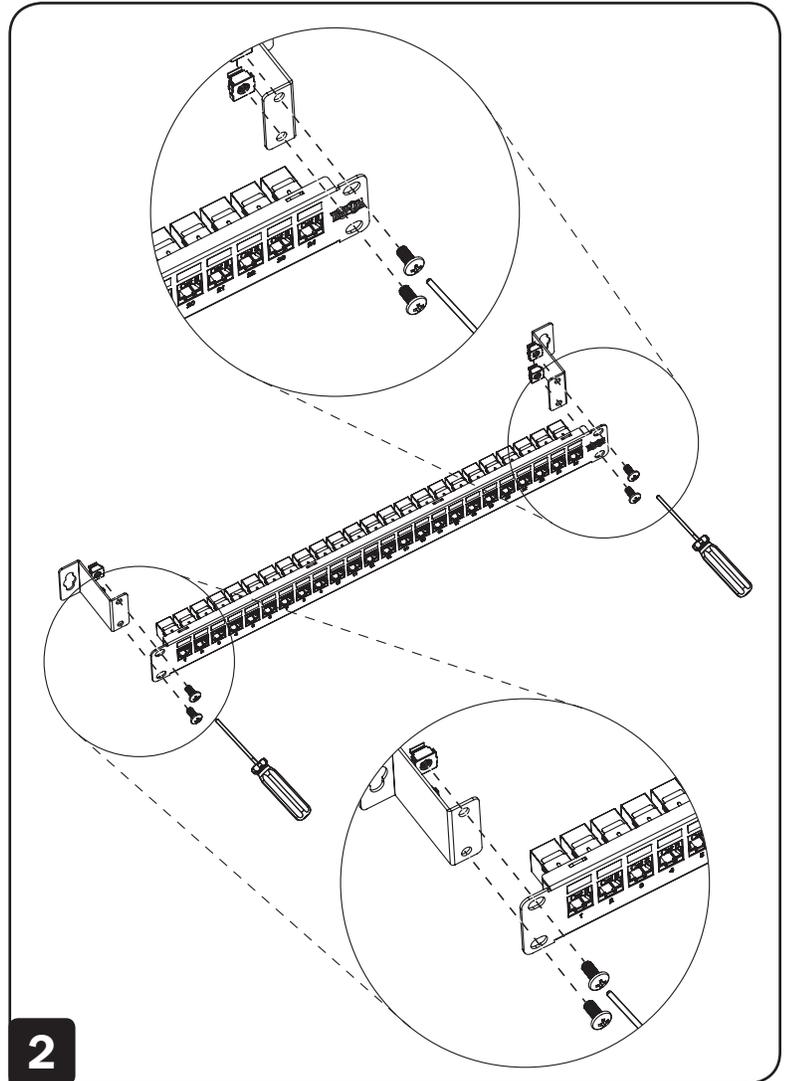
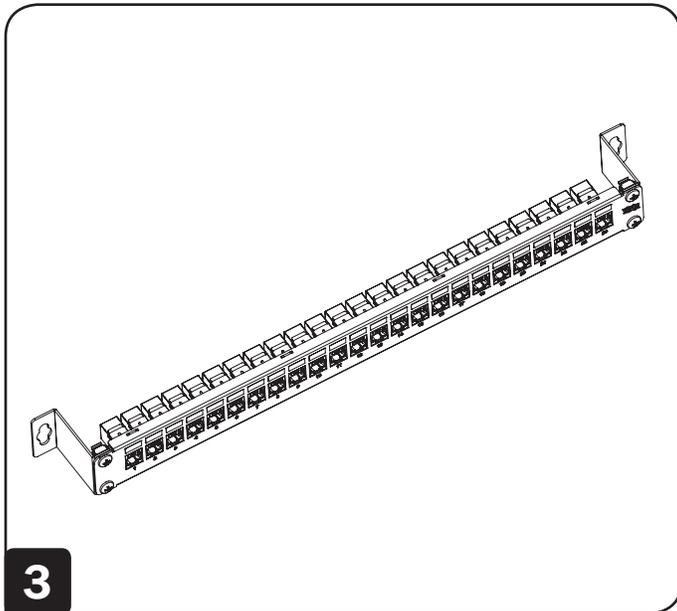


Installation Instructions

N254-024-SH-D 24-Port, 1U Rack-Mount STP Shielded Cat6 Feedthrough Patch Panel

- 1** Attach the grounding wire to the panel. Do not completely tighten until the grounding wire is in its final position.

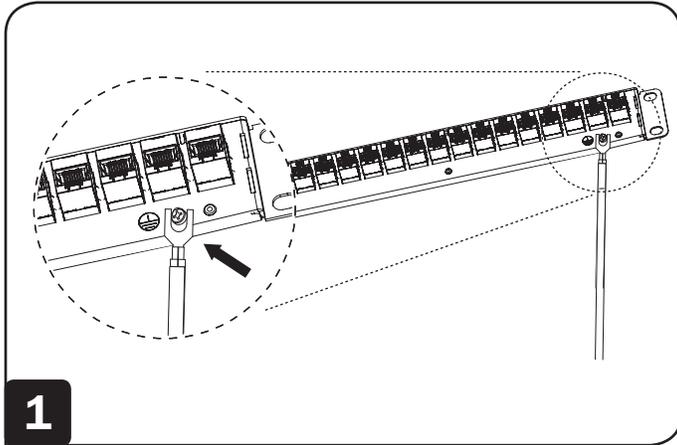

Tripp Lite has a policy of continuous improvement. Specifications are subject to change without notice.

TRIPP·LITE

OVER 90 YEARS
Manufacturing
Excellence.

1111 W. 35th Street, Chicago, IL 60609 USA • www.triplite.com/support

Copyright © 2016 Tripp Lite. All rights reserved.

16-05-328 93-35E5_RevA